


		PEX-07-T	Béton=0.40 m3 Acier=127.6 kg d=315.3 kg/m3 Fi=11.4 mm Cof=4.2 m²	Eb=2.5 cm Eh=2.5 cm El=2.5 cm	$\frac{7}{8}$
	P				
	- Date 27/04/22 - 1 étages -				
	Section : 25 x 50ht				
	Dispositions constructives RPS2011: poutre principale				
	Fc28= 25 MPa Fe= 500 MPa Fissuration peu préjudiciable				

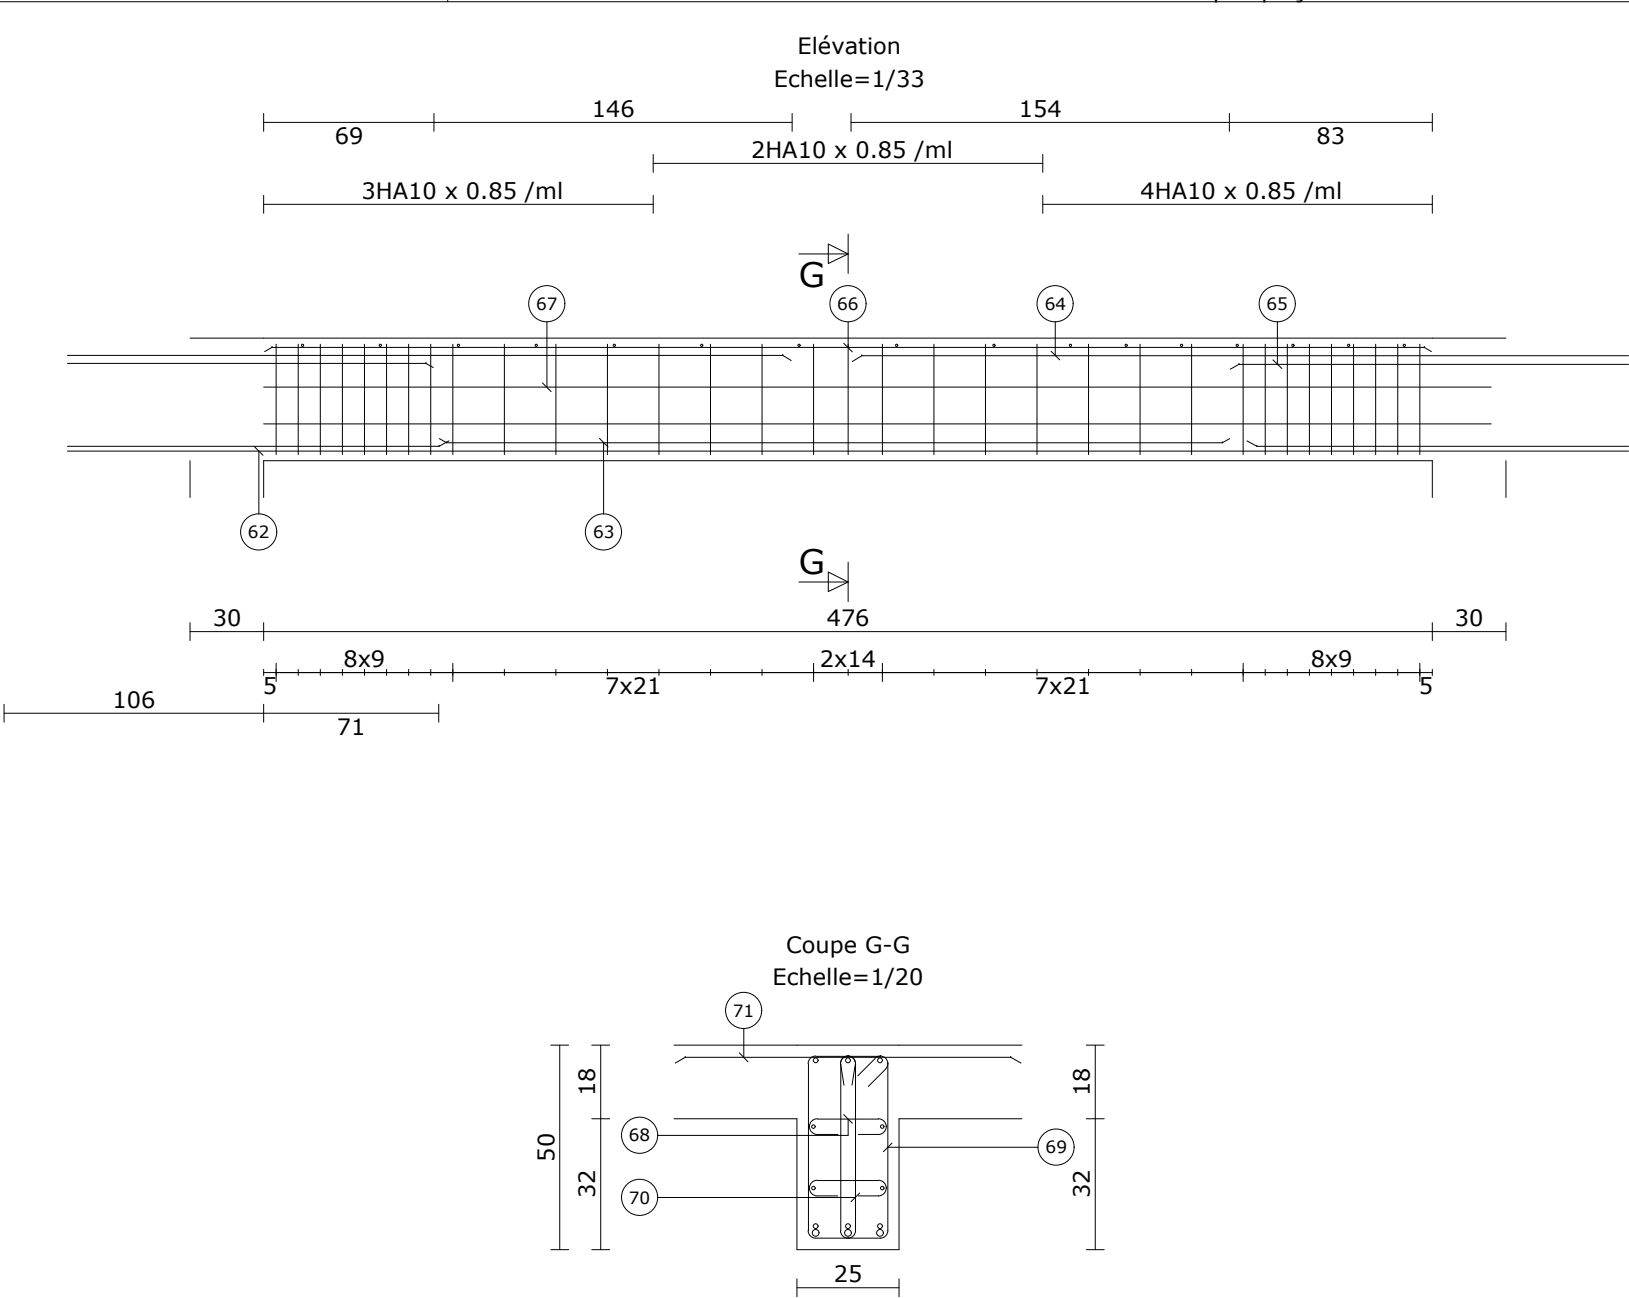

Barre		Lg	Forme
62	3HA16	688	688
63	3HA12	323	323
64	3HA16	473	473
65	3HA14	195	195
66	3HA12	476	476
67	4HA8	500	500
68	66HA8	37	20
69	33HA6	142	20 45
70	33HA6	109	45
71	16HA10	85	85
Barre		Lg/Poids	
HA6		82.9/18.4	
HA8		44.4/17.5	
HA10		13.6/8.4	
HA12		24.0/21.3	
HA14		5.9/7.1	
HA16		34.8/55.0	